



Twin City Water Clinic  
 617 13<sup>th</sup> Ave South  
 Hopkins, MN 55343  
 (952) 935-3556 FAX (952) 935-5077

**CHAIN-OF-CUSTODY RECORD**

<b>Client:</b> Advanced Health Safety & Security  <b>Client Address:</b> 105 Third Street Balaton, MN 56115  <b>Customer Phone No:</b> Brian Parrie 605-430-8842	<b>Contract Lab</b>  <b>Information</b> <b>Ship To:</b>  <b>Ship Date:</b> <b>Courier:</b>
---	--


Lab ID # Lab use only	Date	Time	Sample ID	Sample Location	Lead	Sample by
	2-2-18	2:09	001	1st Floor Bathroom	A	SC
	2-2-18	2:10	002	South Gym	A	SC
	2-2-18	2:20	003	Bathroom across from 122 South	A	SC
	2-2-18	2:25	004	N. Gym	A	SC
	2-2-18	2:33	005	UP Stairs Bathroom	A	SC
	2/2/18	3:09	006	Kitchen Pot Filler	r	BP
	2/2/18	3:10	007	Kitchen East Sink	r	BP
	2/2/18	3:13	008	Bathroom am 120	x	BP
	2/2/18	3:15	009	Kindergarten Room	r	BP
	2/2/18	3:20	010	Preschool Room	r	BP
	2/2/18	3:18	011	Library	r	BP

Relinquished By:	Date	Time	Relinquish To:	Date	Time

Container Intact	Yes	No	Correct Container	Yes	No	Comments:
Cooled	Yes	No	Temperature Blank	Yes	No	


Field of testing: Lead SM3113B  
 TCWC Rev. 1.0a

# Comfrey High School Tornado Evacuation Route

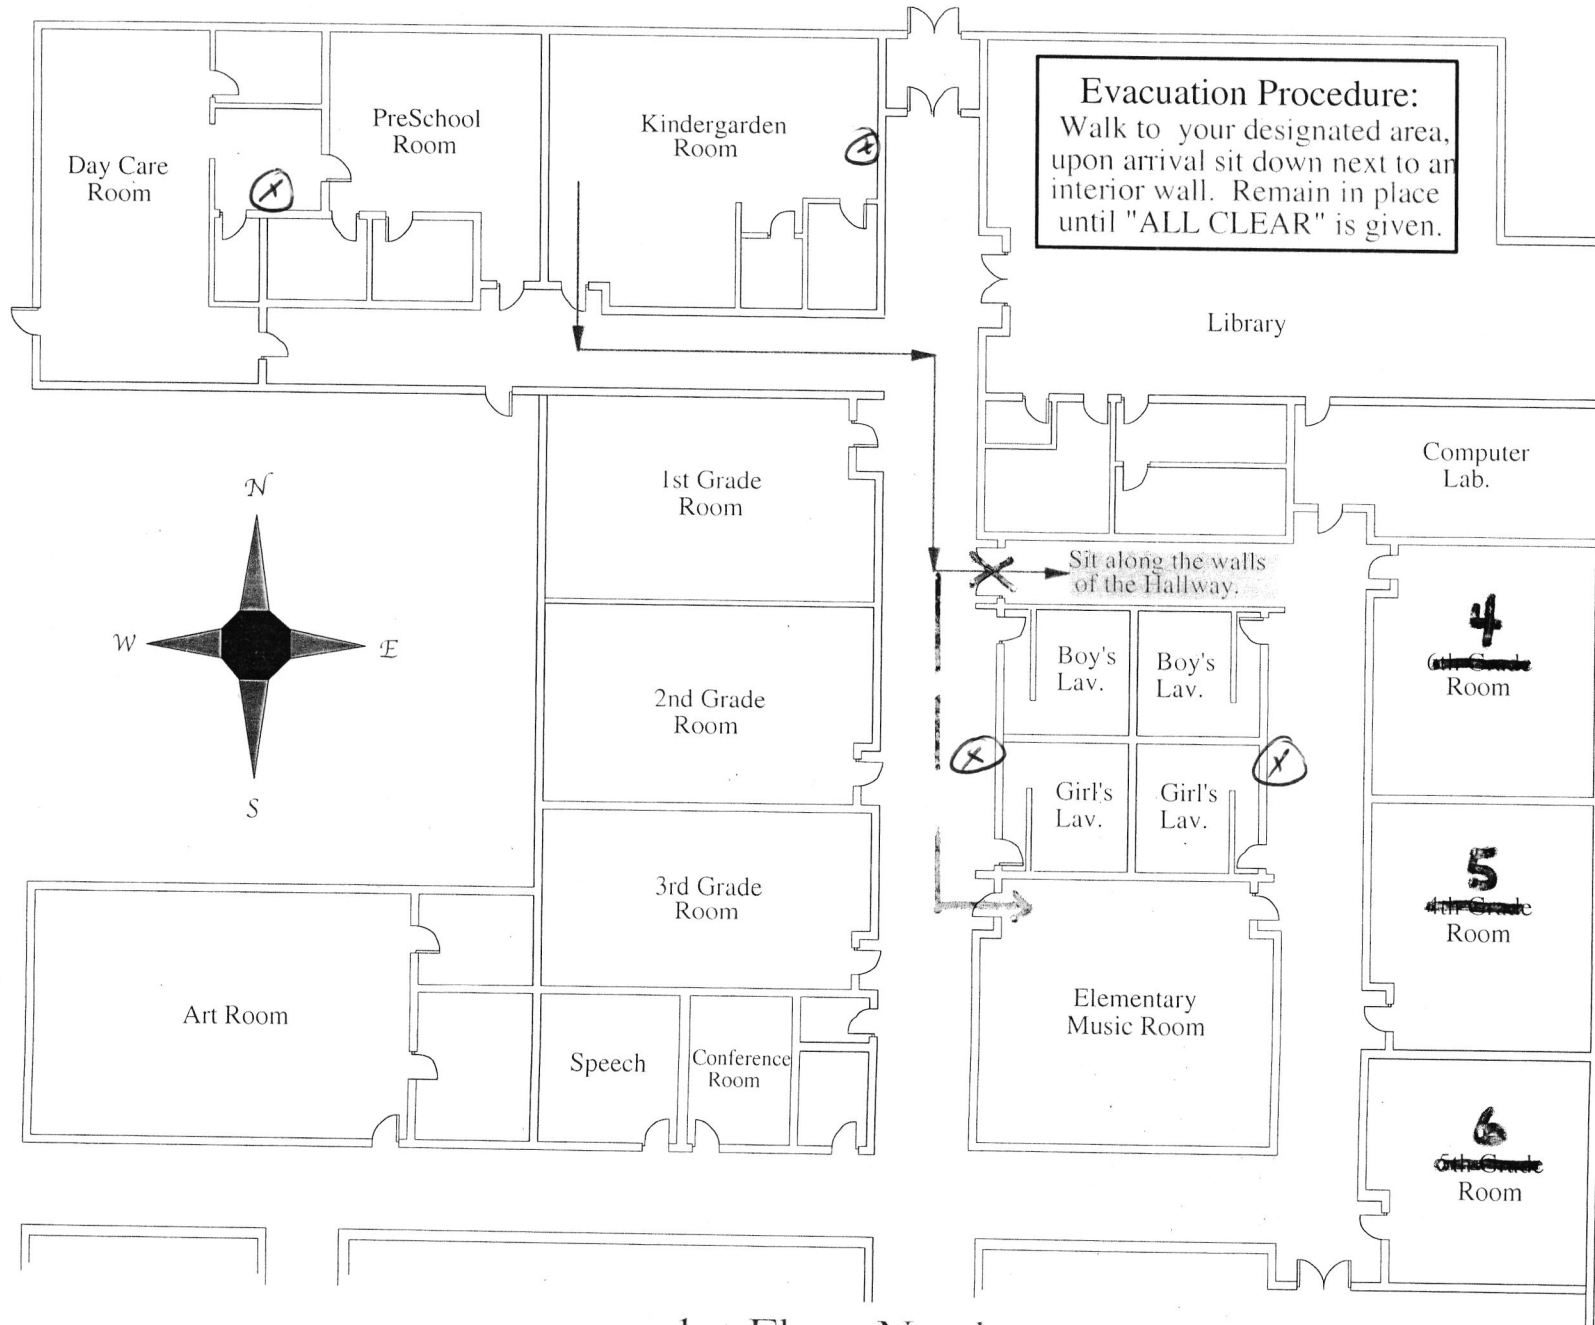

1st Floor North

# Comfrey High School Tornado Evacuation Route

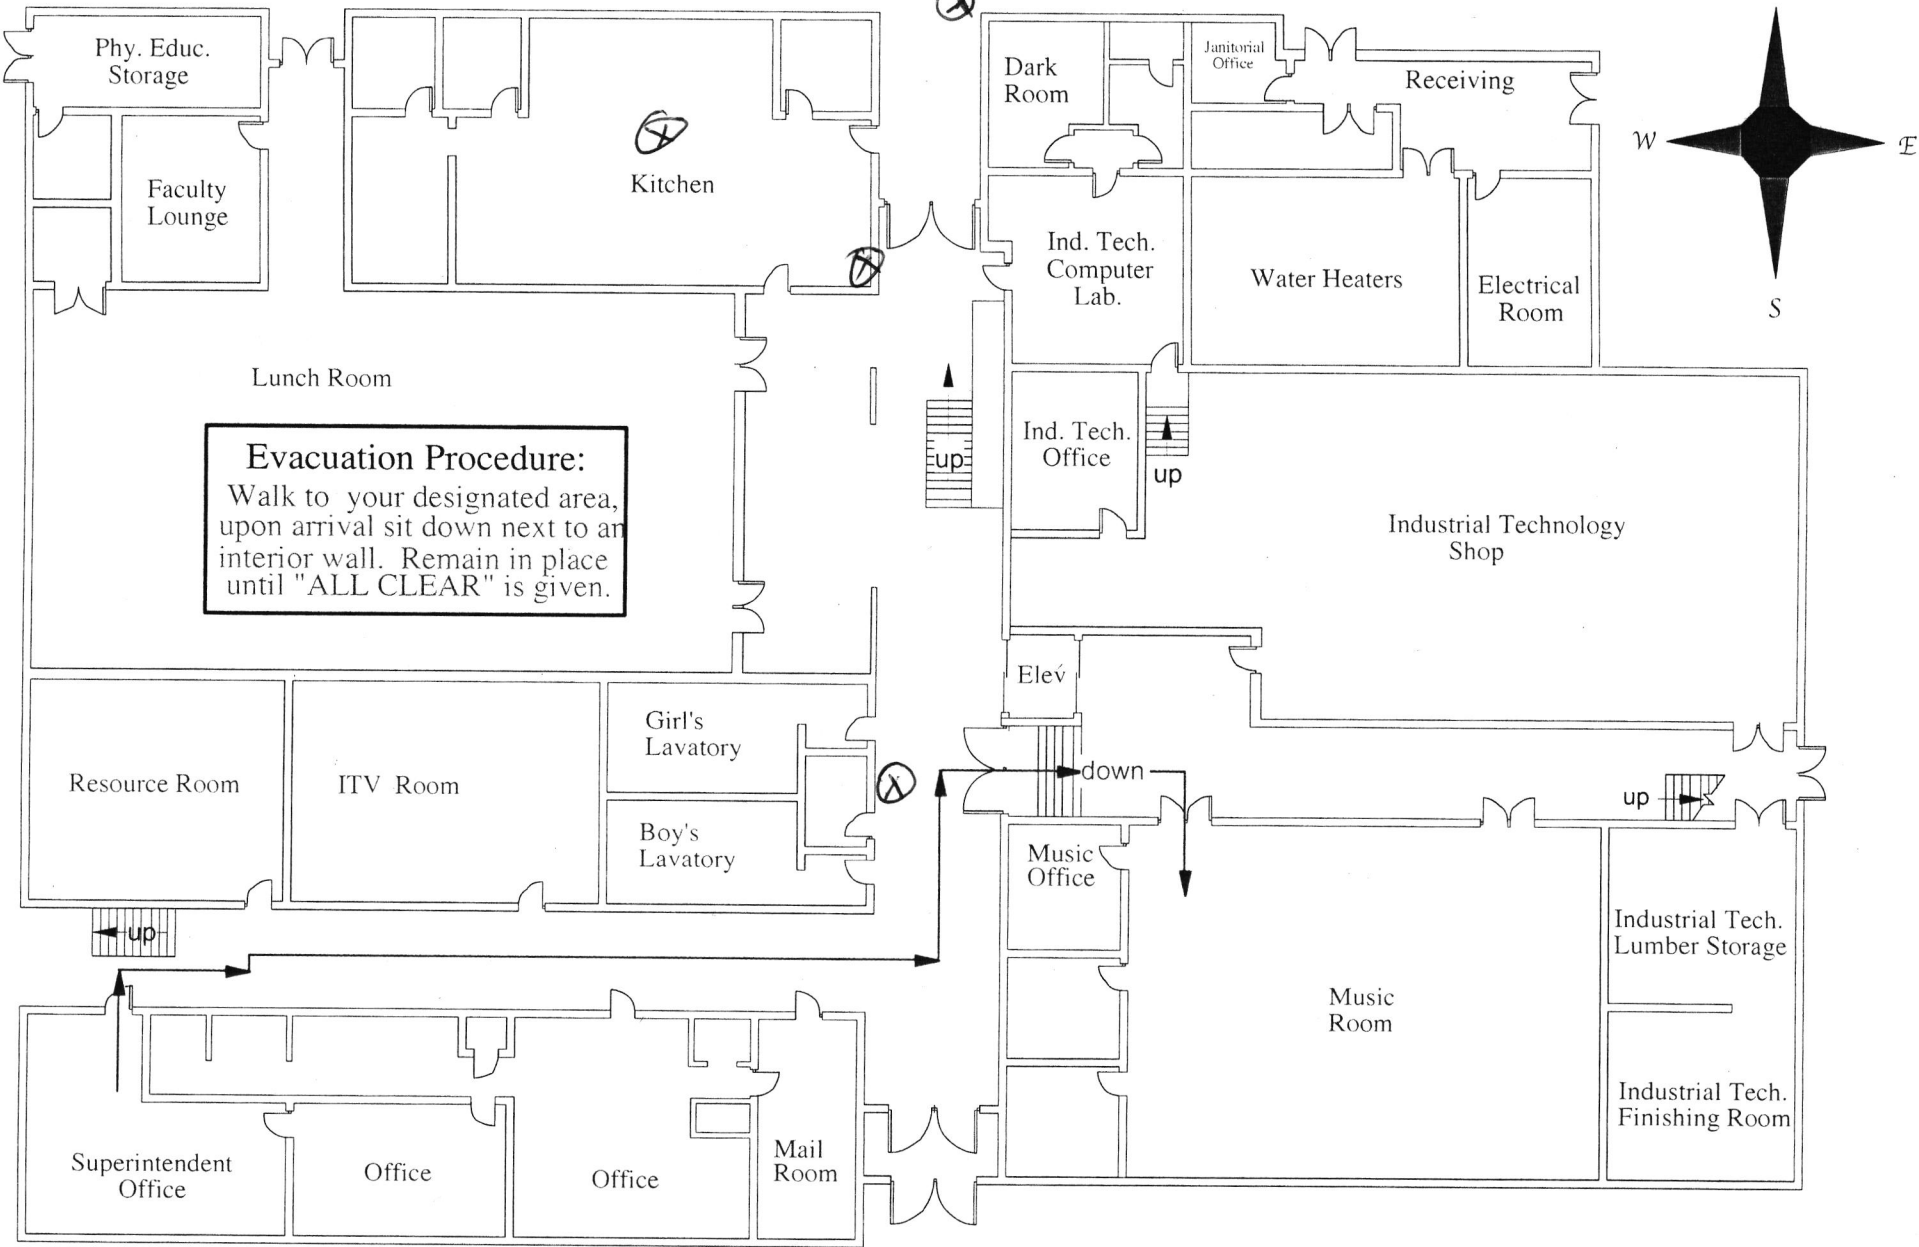

1st Floor South